



THROUGH JOINTS ON EACH
SIDE OF AND AROUND EACH
UTILITY APPURTENANCE.

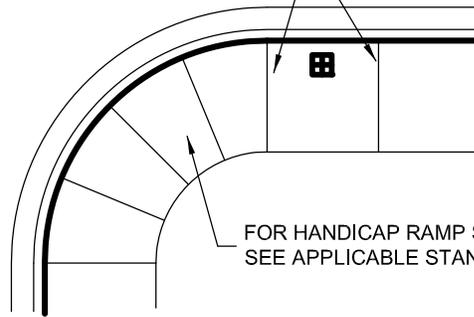


FOR HANDICAP RAMP SIZE AND POSITION,
SEE APPLICABLE STANDARD DETAILS.

SIDEWALK JOINTING

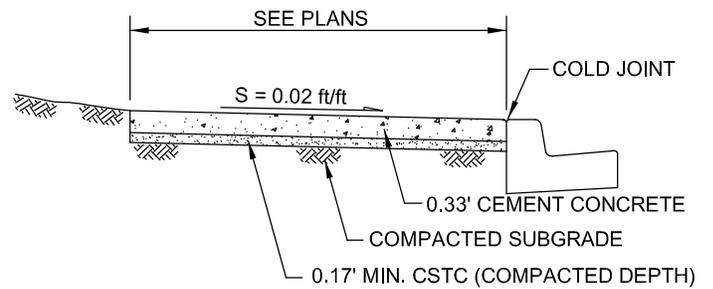

4" STANDARD SECTION

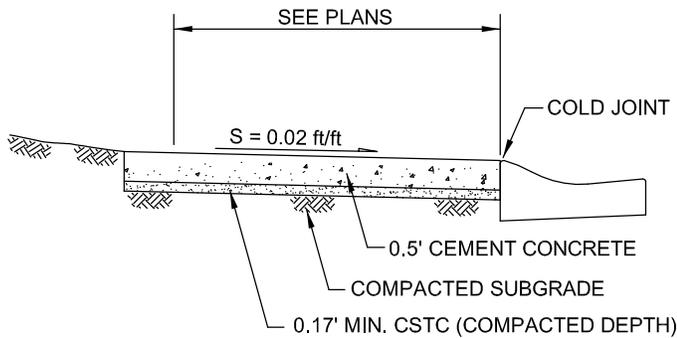

6" SIDEWALK SECTION

NOTES

1. THROUGH JOINTS WITH 3/8" JOINT MATERIAL SHALL BE PLACED AT 20' INTERVALS OR MATCH EXISTING CURB JOINTS.
2. 1 1/2" DEEP DUMMY JOINTS SHALL BE SCORED INTO THE CONCRETE AT ALTERNATING 10' INTERVALS.
3. "V" GROOVES SHALL BE PLACED AT 5' INTERVALS.
4. ALL JOINTS, "V" GROOVES, AND EDGES SHALL BE FINISHED WITH AN EDGER HAVING A 1/4" RADIUS.
5. SEE PLANS FOR WIDTH AND POSITION OF SIDEWALK.
6. WSDOT CLASS 3000 CONCRETE WITH COARSE AGGREGATE GRADING NO. 5.



City Of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail

CEMENT CONCRETE SIDEWALK R5

NOT TO SCALE
Revision 03-2011