



PLAN VIEW

NOTES


1. SIDE SEWER CONNECTIONS NEW SANITARY SEWER MAINS SHALL BE MADE WITH TEES OR WYES AS DIRECTED. ALL CONNECTIONS TO THE STUBS AND EXISTING SEWER MAINS SHALL BE MADE WITH "RIGID TYPE" COUPLERS. ANY DEVIATIONS FROM THIS SHALL BE APPROVED BY THE CITY ENGINEER PRIOR TO USE..
2. WHERE DEPTH IS INSUFFICIENT TO ALLOW CONNECTION AS SHOWN, CONNECT SERVICE AS DIRECTED BY ENGINEER.
3. ALL SIDE SEWER MATERIALS SHALL BE PVC SEWER PIPE CONFORMING TO THE REQUIREMENTS OF SECTION 7-18.2 OF THE STANDARD SPECIFICATIONS.
4. TERMINATE SIDE SEWER AT R/W LINE UNLESS OTHERWISE DIRECTED BY THE ENGINEER OR OTHERWISE ON PLANS.
5. MINIMUM SLOPES ARE AS FOLLOWS:
4" DIA. PIPE = 0.02 ft/ft
6. BACKFILL WITHIN THE RIGHT OF WAY SHALL BE CRUSHED SURFACING TOP COURSE FULL DEPTH AS DIRECTED BY THE ENGINEER.
7. BACKFLOW PREVENTER REQUIRED ON ALL CONNECTIONS
8. NO SERVICE CONNECTIONS TO PIPES 12" OR LARGER WITHOUT PRIOR APPROVAL OF THE CITY ENGINEER.

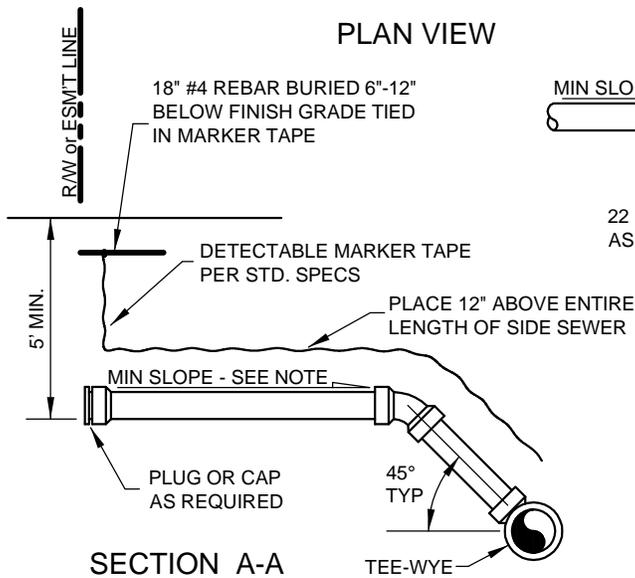

SECTION A-A

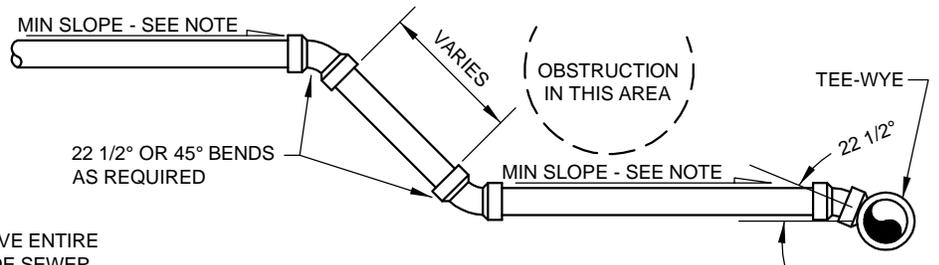

CONNECTION AT OBSTRUCTION



City of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail
SIDE SEWER CONNECTION

NOT TO SCALE
Revision 09-2013