


PLAN VIEW



NOTES

1. MANHOLES MAY BE STANDARD REINFORCED CONCRETE SECTIONS 24" I.D. x 4'-0". IF MORE THAN ONE SECTION IS USED, INSTALL RAMNEK AT JOINTS. NO STEPS UNLESS THE DEPTH EXCEEDS 4' DEPTH AND MANHOLE MATERIAL AS APPROVED BY THE CITY ENGINEER.
2. INSTALL RAMNEK SEAL UNDER COVER FRAME ENTIRELY AROUND MANHOLE.
3. SAMPLING PORT IS TO BE LOCATED IN A PUBLIC UTILITY EASEMENT WHERE IT CAN BE ACCESSED AT ANY TIME BY CITY FORCES. LOCATION AS APPROVED BY THE CITY ENGINEER.
4. NO OTHER APPARATUS SHALL BE INSTALLED IN THE SAMPLING PORT MANHOLE.
5. SAMPLING PORT MANHOLE LID SHALL NOT BE OF A BOLT DOWN TYPE BUT MAY BE CAST IRON OR AS APPROVED BY THE CITY ENGINEER.
6. 0.10' DROP IN CHANNELS ACROSS MANHOLE
7. SAMPLING MANHOLE SHALL NOT BE PLACED IN A LOCATION WHERE IT CAN BE BLOCKED BY A VEHICLE.

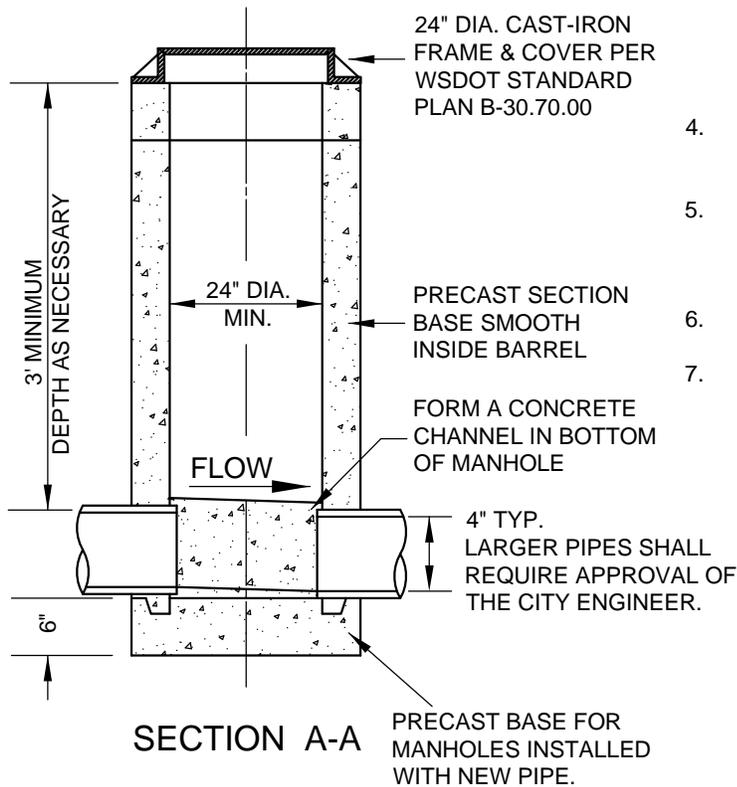

City of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail
SAMPLING MANHOLE

NOT TO SCALE
Revision 10-2014

S8