




NOTES

1. ROMAC "GRIP RING" MECHANICAL JOINT ACCESSORY KITS SHALL BE USED ON ALL MECHANICAL JOINT CONNECTIONS FROM TEE TO HYDRANT. U.S. FIELD-LOK GASKET FOR ANY PIPE BELL JOINT.
2. MINIMUM HYDRANT DEPTH IS 4.5 FEET. THIS DISTANCE MAY INCREASE WHEN HYDRANTS ARE INSTALLED ON DISTRIBUTION MAIN SIZES LARGER THAN 6 INCHES IN DIAMETER OR MAINS AT GREATER DEPTH.
3. NO EXTENSION ALLOWED ON NEW FIRE HYDRANT INSTALLATIONS UNLESS OTHERWISE APPROVED.
4. AFTER INSTALLATION, PAINT HYDRANT BODY WITH MOORE'S URETHANE GLOSS SAFETY YELLOW. PAINT HYDRANT BONNET AND PORT CAPS WITH SAFETY BLACK.
5. APPROVED FIRE HYDRANTS - M+H MDL. 129, MUELLER SUPER CENTURION 250.
6. BOLLARDS MAY BE REQUIRED AT THE DISCRETION OF THE ENGINEER OR INSPECTOR TO PROTECT THE CITY WATER SYSTEM. SEE STANDARD DETAIL W7.

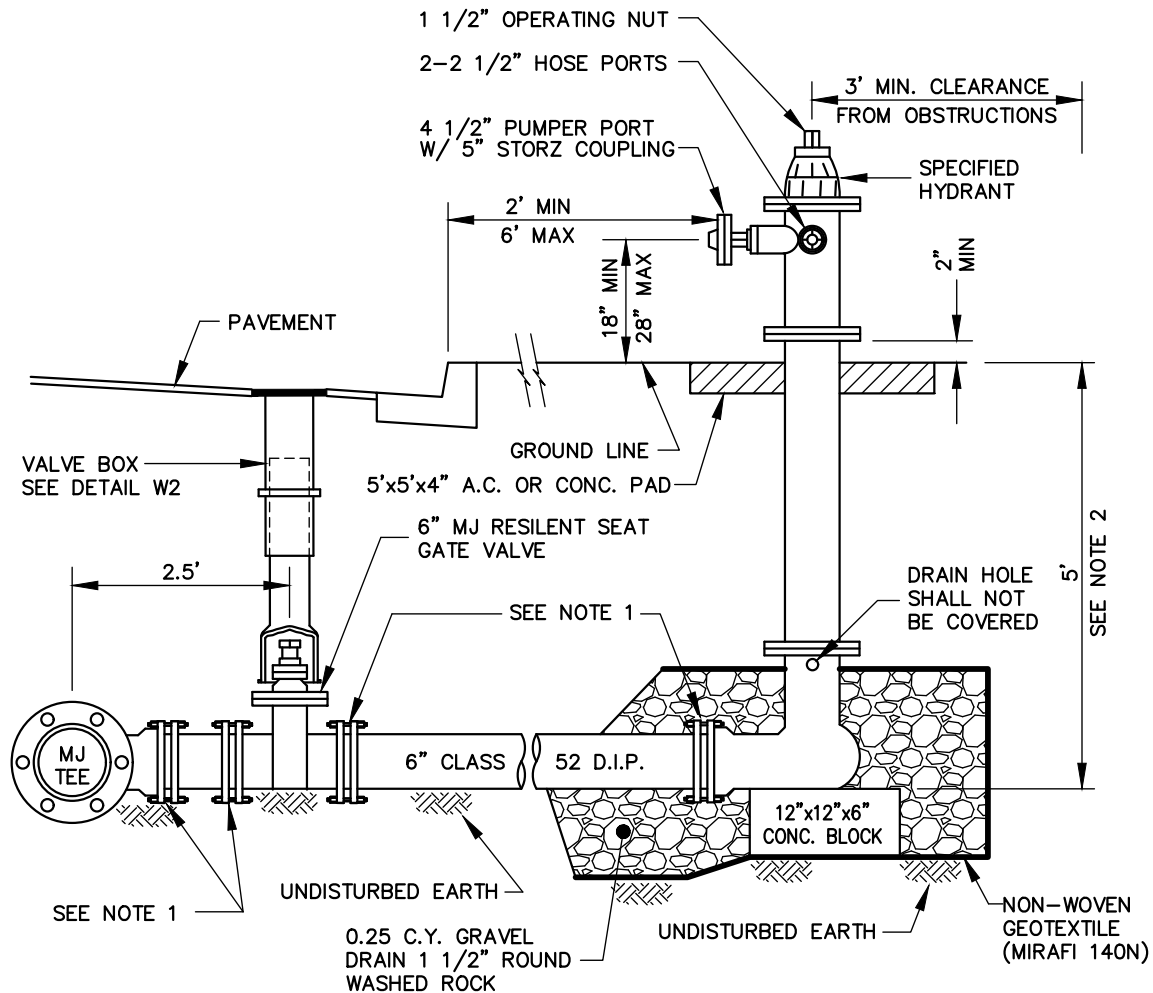

City Of Yakima
 Engineering Division

129 North Second Street
 Yakima, Washington

City of Yakima - Standard Detail HYDRANT ASSEMBLY

NOT TO SCALE
 Revision 05-2025

W1