




NOTES

1. ROMAC "GRIP RING" MECHANICAL JOINT ACCESSORY KITS SHALL BE USED ON ALL MECHANICAL JOINT CONNECTIONS FROM TEE TO HYDRANT. U.S. FIELD-LOK GASKET FOR ANY PIPE BELL JOINT.
2. MINIMUM HYDRANT DEPTH IS 4.5 FEET. THIS DISTANCE MAY INCREASE WHEN HYDRANTS ARE INSTALLED ON DISTRIBUTION MAIN SIZES LARGER THAN 6 INCHES IN DIAMETER OR MAINS AT GREATER DEPTH.
3. NO EXTENSION ALLOWED ON NEW FIRE HYDRANT INSTALLATIONS UNLESS OTHERWISE APPROVED.
4. AFTER INSTALLATION, PAINT HYDRANT BODY WITH BENJAMIN MOORE HP2200 ALKYD URETHANE ENAMEL GLOSS SAFETY YELLOW. PAINT HYDRANT BONNET AND PORT CAPS WITH SAFETY BLACK.
5. APPROVED FIRE HYDRANTS - M+H MDL. 129, MUELLER SUPER CENTURION 250.

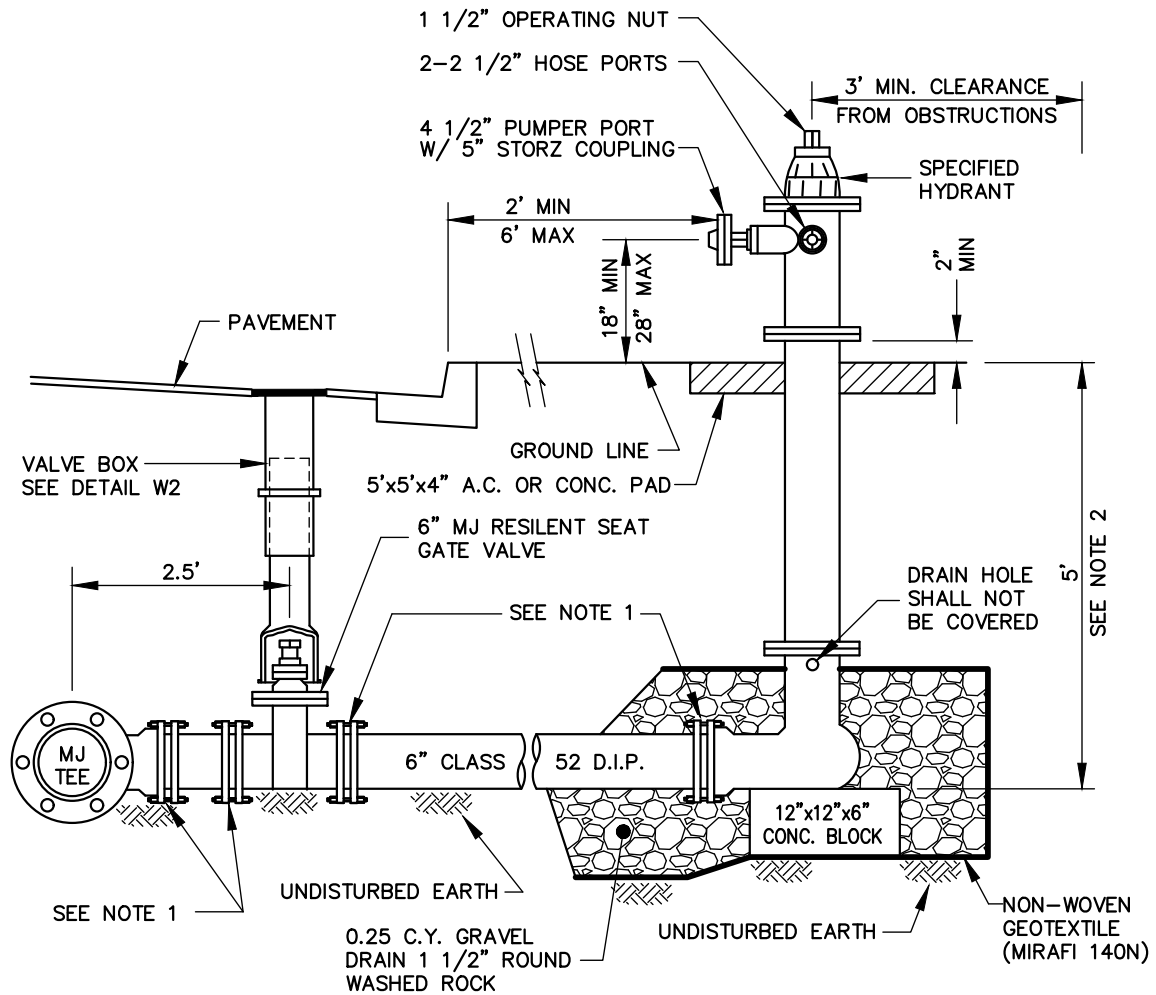

City Of Yakima
 Engineering Division

129 North Second Street
 Yakima, Washington

City of Yakima - Standard Detail HYDRANT ASSEMBLY

NOT TO SCALE
 Revision 2-2025

W1