



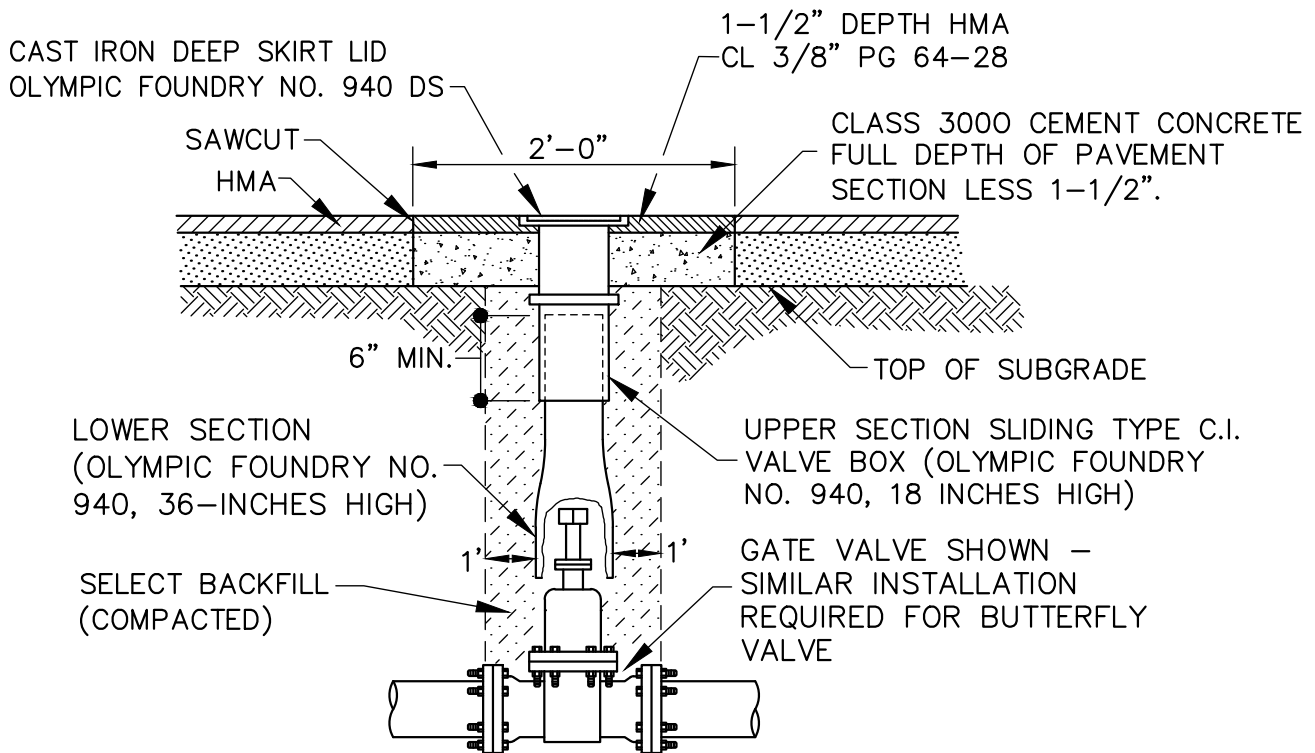

SLIDE LOCK NOTCHES IN BOX
TOP TO BE IN LINE WITH
WATER MAIN, FIRE HYDRANT
SERVICE OR SERVICE MAIN

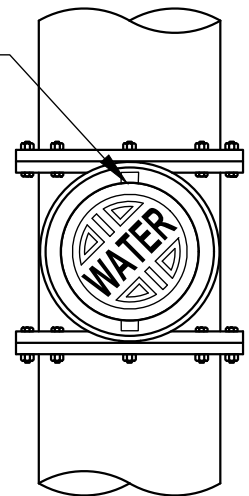

NOTES

PROVIDE EXTENSION PIECE WHERE REQUIRED FOR VALVE BOX.
(OLYMPIC FOUNDRY NO. 940, 12--INCHES HIGH)

VALVE BOX LID EARS SHOULD BE IN DIRECTION OF MAIN.

VALVE NUTS OVER 5' DEEP REQUIRE A VALVE STEM EXTENSION TO
BRING OPERATING NUT TO A DEPTH OF 4' (+/- 6")



City Of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail
WATER VALVE BOX

NOT TO SCALE
Revision 05 - 2025

W2