


COMPLETE VALVE BOX
TO BE SUPPLIED AND
INSTALLED BY CONTRACTOR.

UPPER SECTION OF VALVE
BOX (RICH MODEL 940-B)

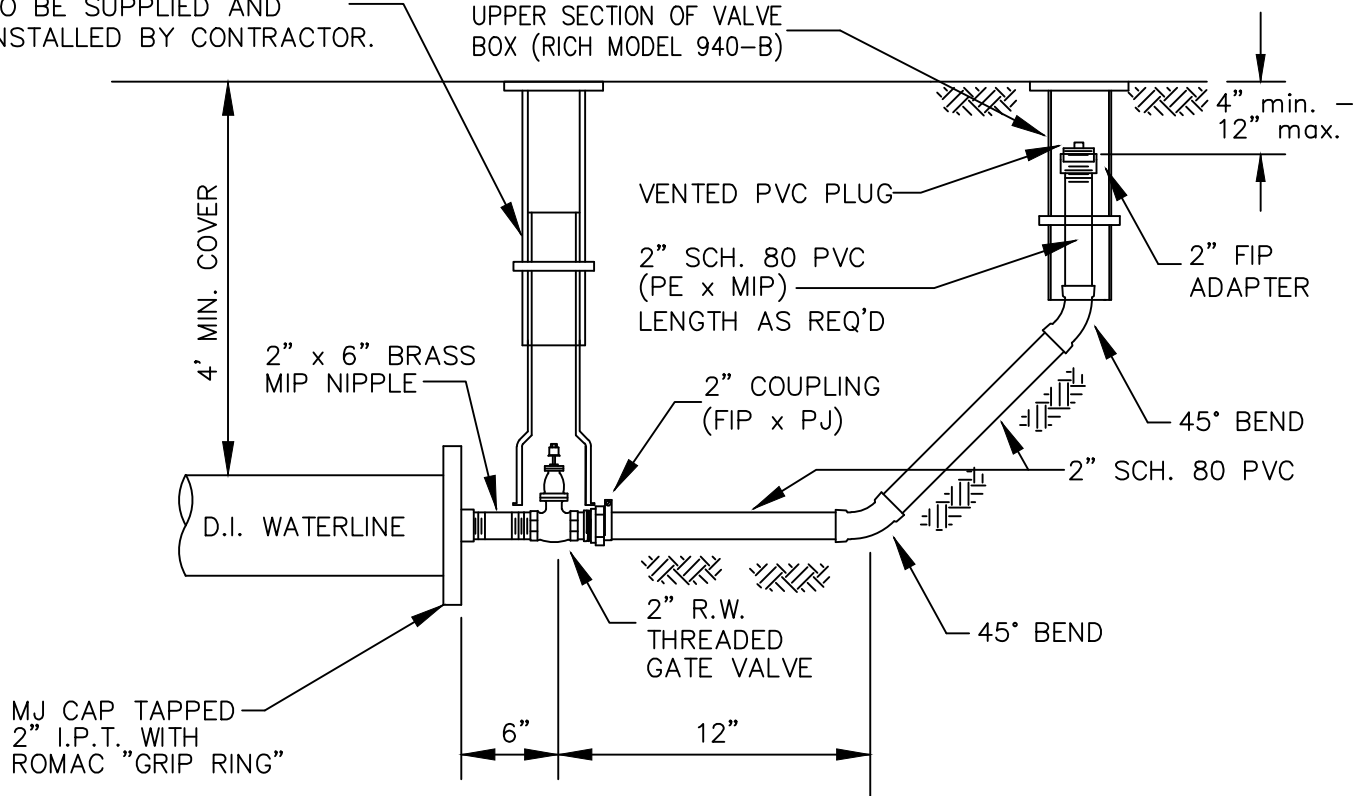

NOTES

1. RESTRAIN MINIMUM OF 70 LF OF PIPE WITH FIELD-LOK GASKETS PRIOR TO BLOW OFF ASSEMBLY.

W5 TYPICAL BLOW OFF ASSEMBLY
NTS City of Yakima – Engineering Division

APPROVED: 11.15.16