




NOTES

1. AIR-VENT PIPING AND ARV TILE TO BE SET BEHIND CURB LINE OR BACK OF SIDEWALK
2. SLOPE TUBING TO PROVIDE CONTINUOUS RISE IN PIPE FROM CORPORATION BALL VALVE TO AIR-VACUUM VALVE.
3. ALL BRASS TO BE NON-LEAD
4. BOLLARDS MAY BE REQUIRED AT THE DISCRETION OF THE ENGINEER OR INSPECTOR TO PROTECT THE CITY WATER SYSTEM. SEE STD. DETAIL W7.

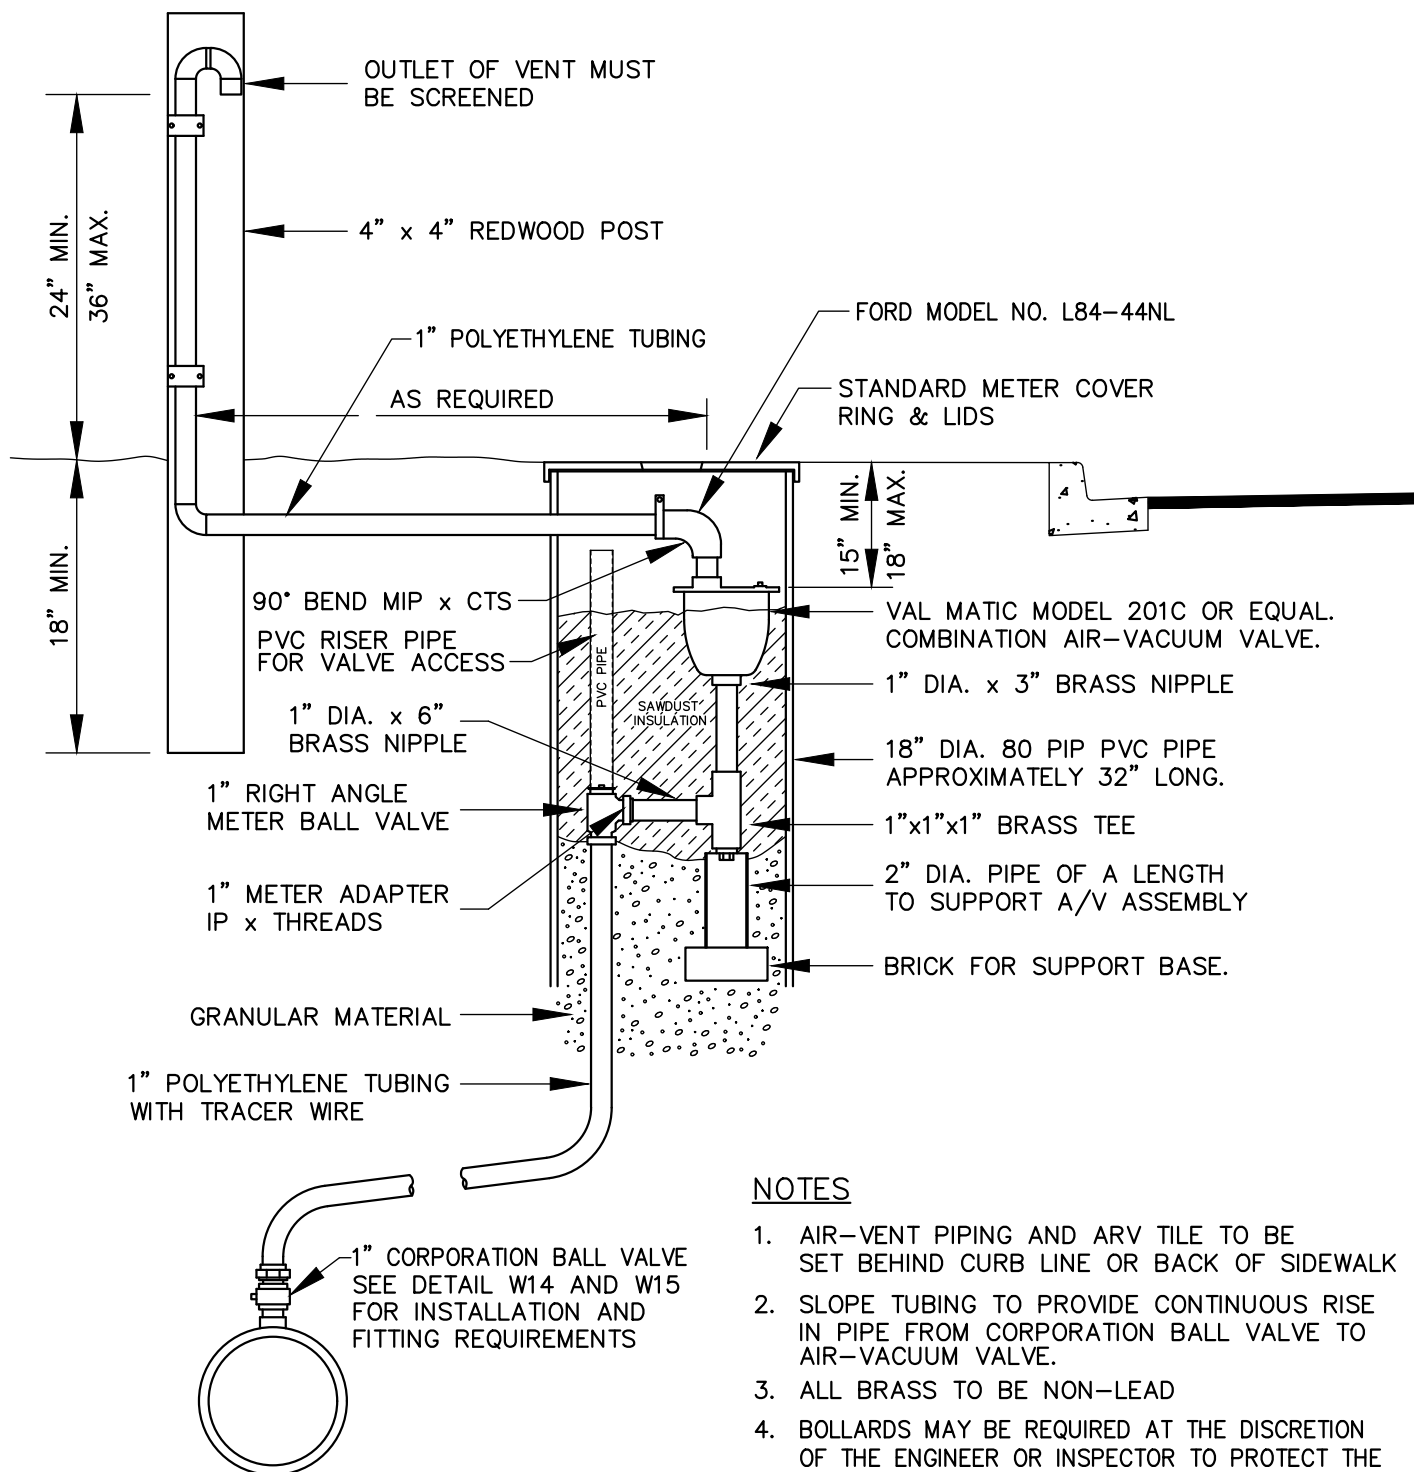

City Of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail
AIR-VACUUM RELIEF VALVE

W8

NOT TO SCALE
Revision 05-2025