


2" TAPS FOR 1 1/2" AND 2" DIA. SERVICES SHALL BE MADE UTILIZING A TWO STRAP TAPPING SADDLE, HAVING IP THREADS. TAPPING SHALL BE DONE WITH A MUELLER MODEL D-5 TAPPING MACHINE ALL IN ACCORDANCE WITH THE INSTRUCTIONS INCLUDED WITH SAID TAPPING MACHINE.

APPROX. PARALLEL TO FINISHED SURFACE

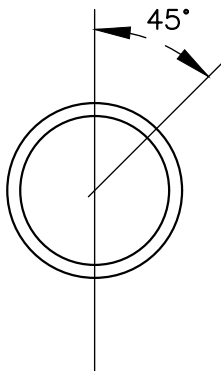

TAPS FOR 1" DIA. SERVICES SHALL BE MADE UTILIZING A MUELLER MODEL B-101 TAPPING MACHINE. THREADS SHALL BE CC. TAPS SHALL BE IN ACCORDANCE WITH THE INSTRUCTIONS INCLUDED WITH SAID TAPPING MACHINE.

NOTES

1. ALL 1" CORPORATION STOPS SHALL BE 1"-FB1000-4-NL BALL VALVES
2. 1 1/2" AND 2" DIA. SERVICES TO HAVE 2" THREADED RS GATE VALVE AT POINT OF CONNECTION.



City Of Yakima
Engineering Division

129 North Second Street
Yakima, Washington

City of Yakima - Standard Detail
TAPPING PROCEDURE DETAIL

NOT TO SCALE
Revision 11-2024

W15