


2" TAPS FOR 1 1/2" AND 2" DIA. SERVICES SHALL BE MADE UTILIZING A TWO STRAP TAPPING SADDLE, HAVING IP THREADS. TAPPING SHALL BE DONE WITH A MUELLER MODEL D-5 TAPPING MACHINE ALL IN ACCORDANCE WITH THE INSTRUCTIONS INCLUDED WITH SAID TAPPING MACHINE.

APPROX. PARALLEL TO FINISHED SURFACE

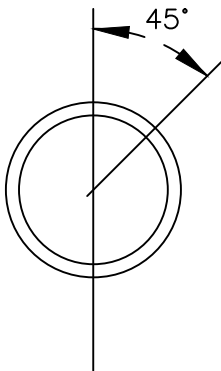

TAPS FOR 3/4" AND 1" DIA. SERVICES SHALL BE MADE UTILIZING A MUELLER MODEL B-101 TAPPING MACHINE. THREADS SHALL BE CC TAPS SHALL BE IN ACCORDANCE WITH THE INSTRUCTIONS INCLUDED WITH SAID TAPPING MACHINE.

NOTES

1. ALL 3/4" AND 1" CORPORATION STOPS SHALL BE BALL VALVES
2. 1 1/2" AND 2" DIA. SERVICES TO HAVE 2" THREADED RS GATE VALVE AT POINT OF CONNECTION.

W15 TAPPING PROCEDURE DETAIL
 NTS City of Yakima – Engineering Division

APPROVED: 11.15.16