


SYMMETRICAL ABOUT CENTERLINE
OF WATER MAIN

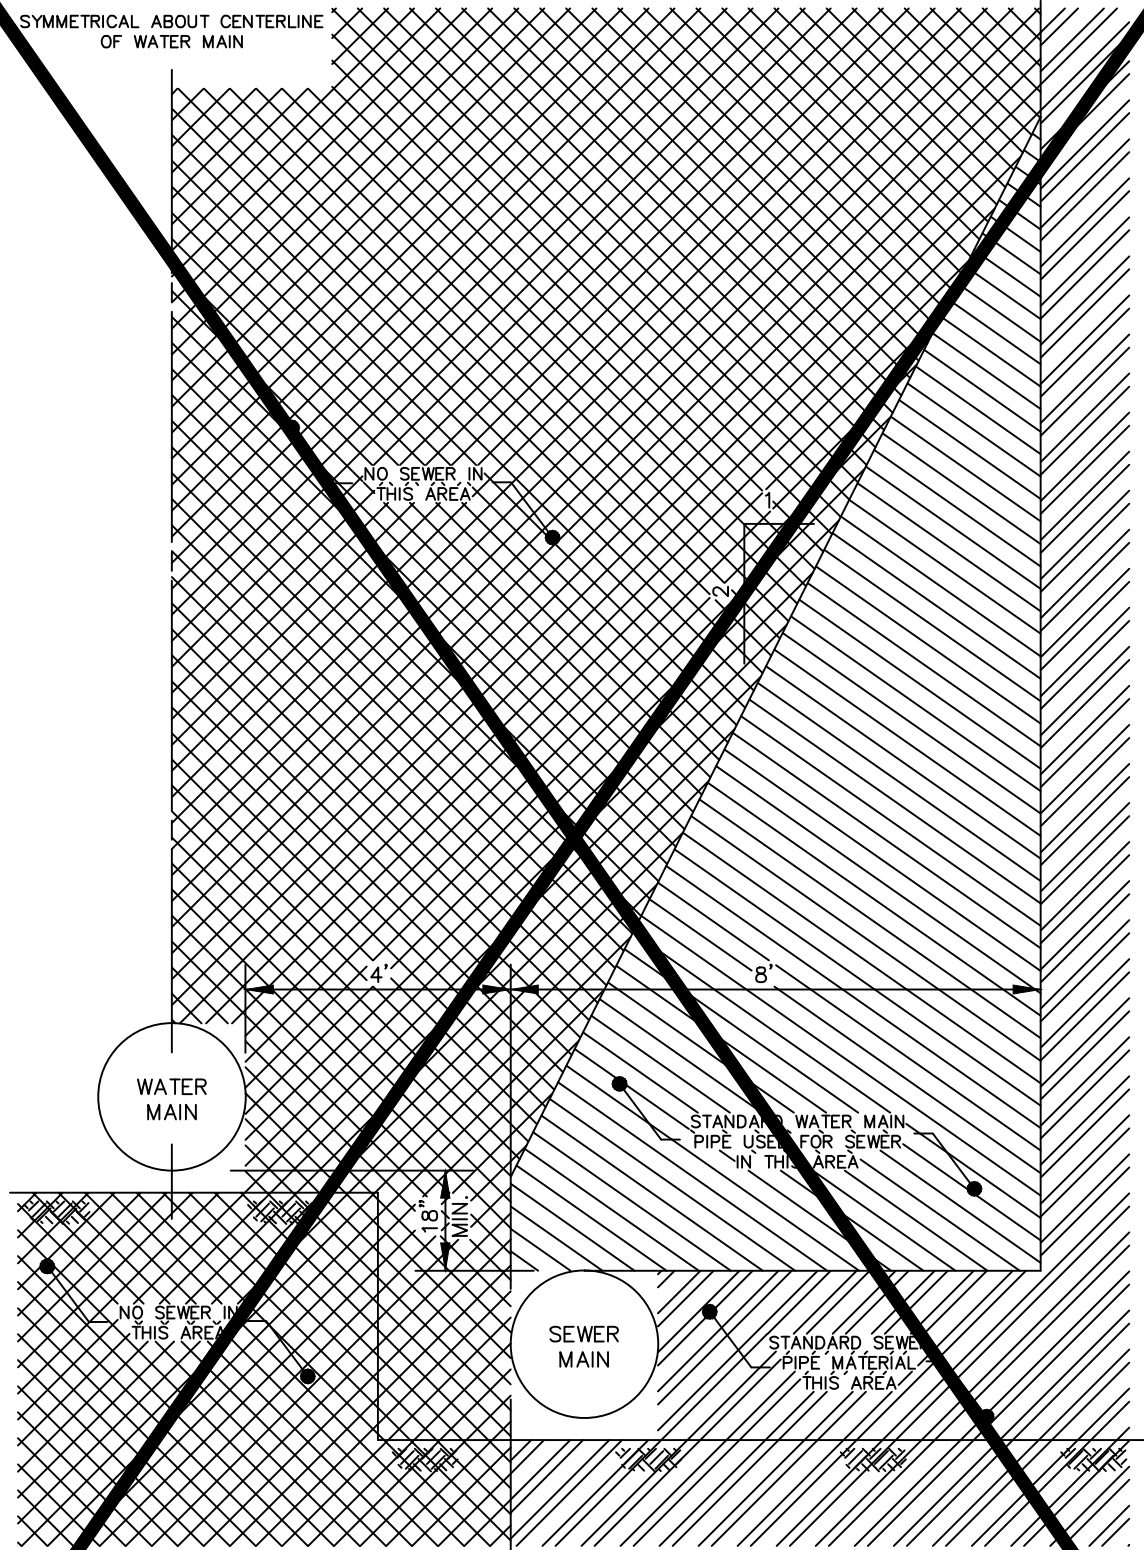

W16 PARALLEL WATER/SEWER SEPARATION
NTS City of Yakima - Engineering Division

*** SEE DOCUMENT "WATERLINE SEPARATION FROM
NONPOTABLE CONVEYANCE SYSTEMS" FOR SEPARATION
REQUIREMENTS

APPROVED: 7.9.99